



# Lead / Lag Control Panel


## PRODUCT DATA & INSTALLATION

Bulletin B40-BLC-PDI-5  
Part # 1068827

	PRODUCT SUPPORT	scan:
	web: <a href="http://b-rp.ca/blc">b-rp.ca/blc</a>	
	email: <a href="mailto:smcu@b-rp.ca">smcu@b-rp.ca</a>	
	call: 1-844-893-3222 x521	

## Model BLC1 / BLC2

**Electrical Power:**  
115/1/60,  
208-230/1/60,  
200-220/1/50

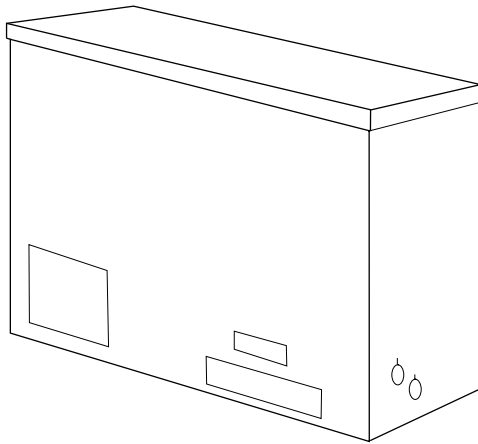

### NOMENCLATURE

BLC 1 - I S2 A

**Model**

Bally Lead Lag Control Panel

**Model Code**

1 = Standard  
2 = With Alarm/Auto Back-Up

**Application**

I = Indoor

**Voltage**

S1 = 115/1/60  
S2 = 208-230/1/60  
S6 = 200-220/1/50

**Series / Generation**

A = 1st Generation


- For use on TWO independent refrigeration systems using pumpdown control mode. (Thermostat wired into liquid line solenoid valve).
- Panel can be mounted at condensing unit on indoor installations or can be mounted remote inside on a wall when used with outdoor condensing units.
- Designed to alternate each system automatically at a preset 24 hour time period. (can be readjusted from a 6 to 300 hour time period).

Three position toggle switch provides:


1. Condensing Unit #1 runs only.
2. Lead Lag mode. (alternates unit #1 and unit #2 automatically).
3. Condensing unit #2 runs only.

- BLC1 model offers low cost simple operation by automatically (pre-set time) or manually alternating each unit.
- BLC2 model offers the same as BLC1 and includes supplemental refrigeration backup during abnormal load situations or in the event one refrigeration system fails. (Includes alarm dry contacts)
- Panel is suitable for use with Air, Electric and Hot Gas defrost systems.
- Custom designed panels available to suit any specific customer requirement (contact factory)


## PANEL LEAD-LAG WIRING - BLC1

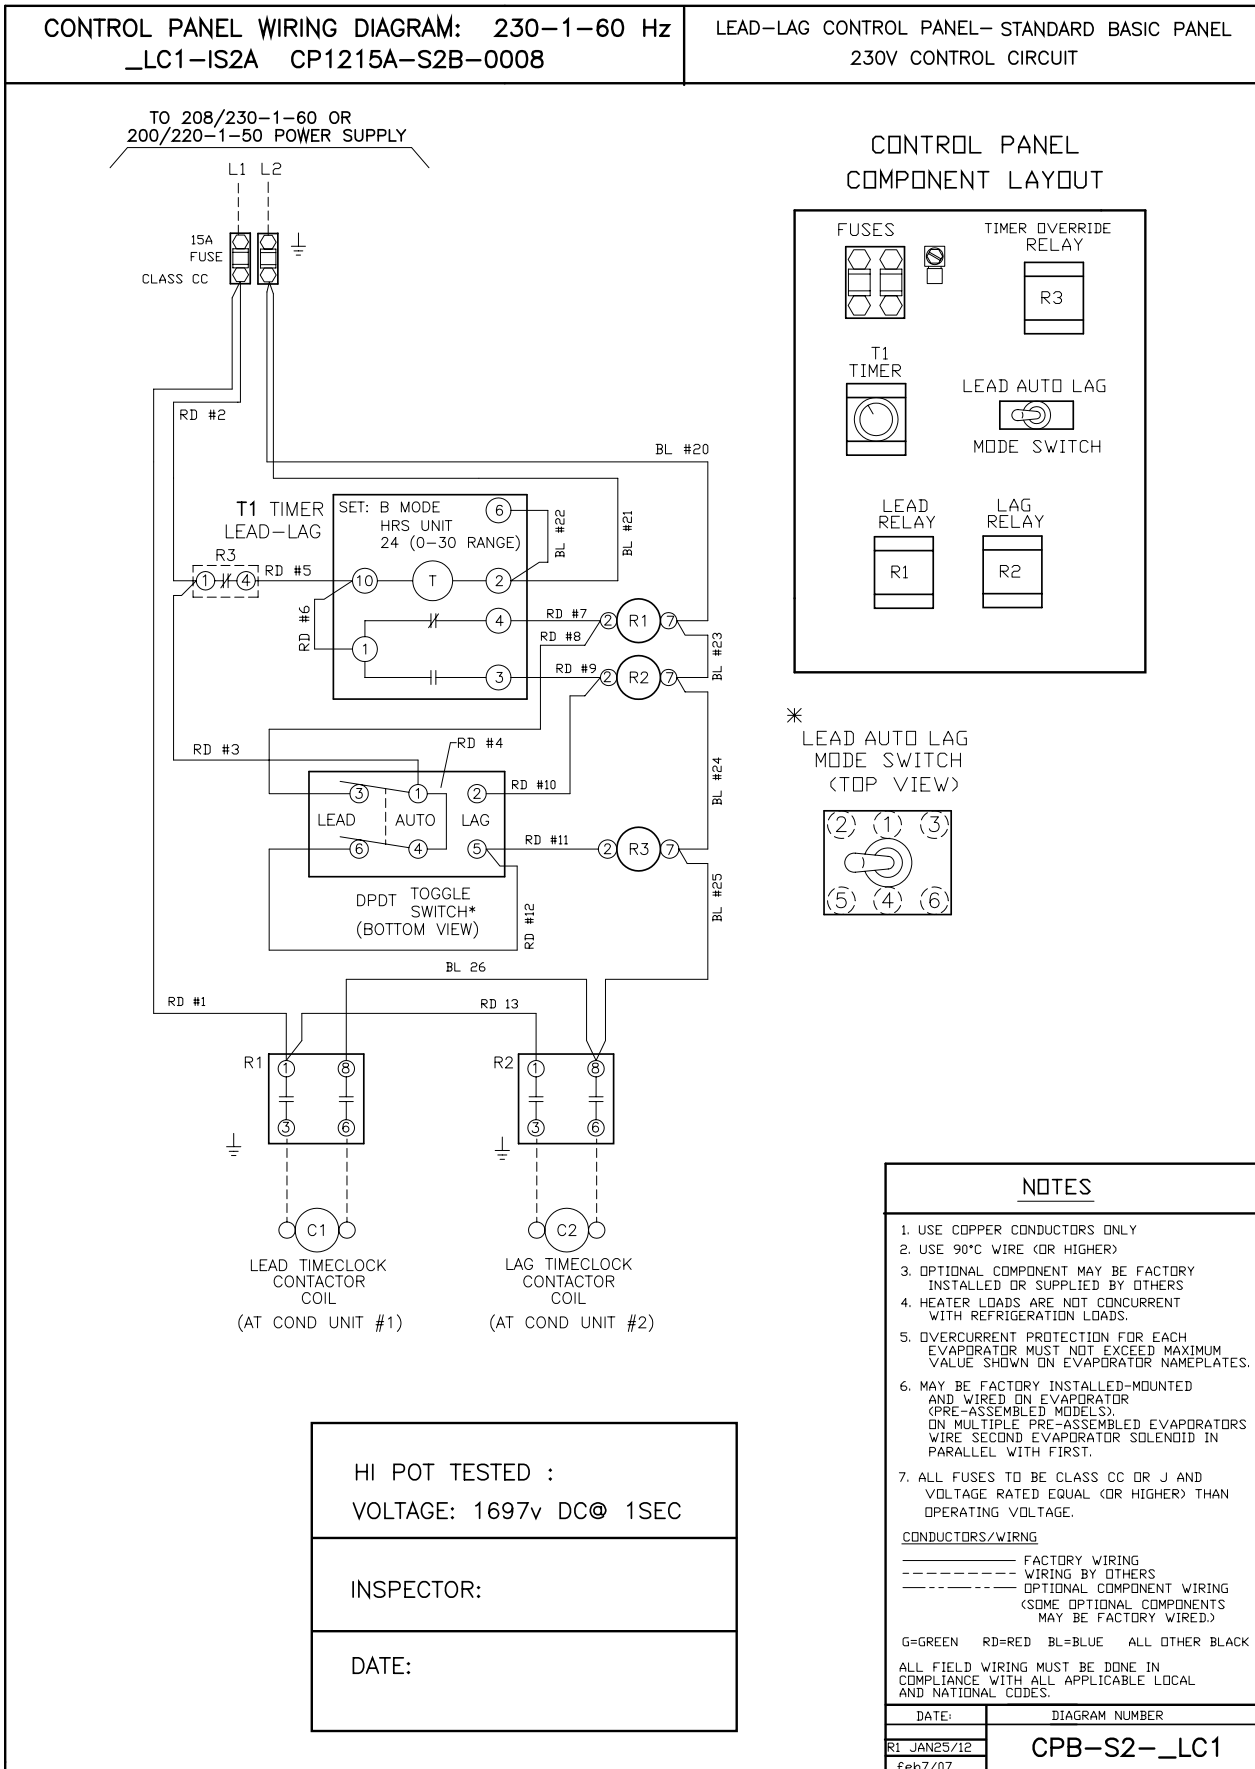


## SYSTEM LEAD-LAG WIRING - BLC1

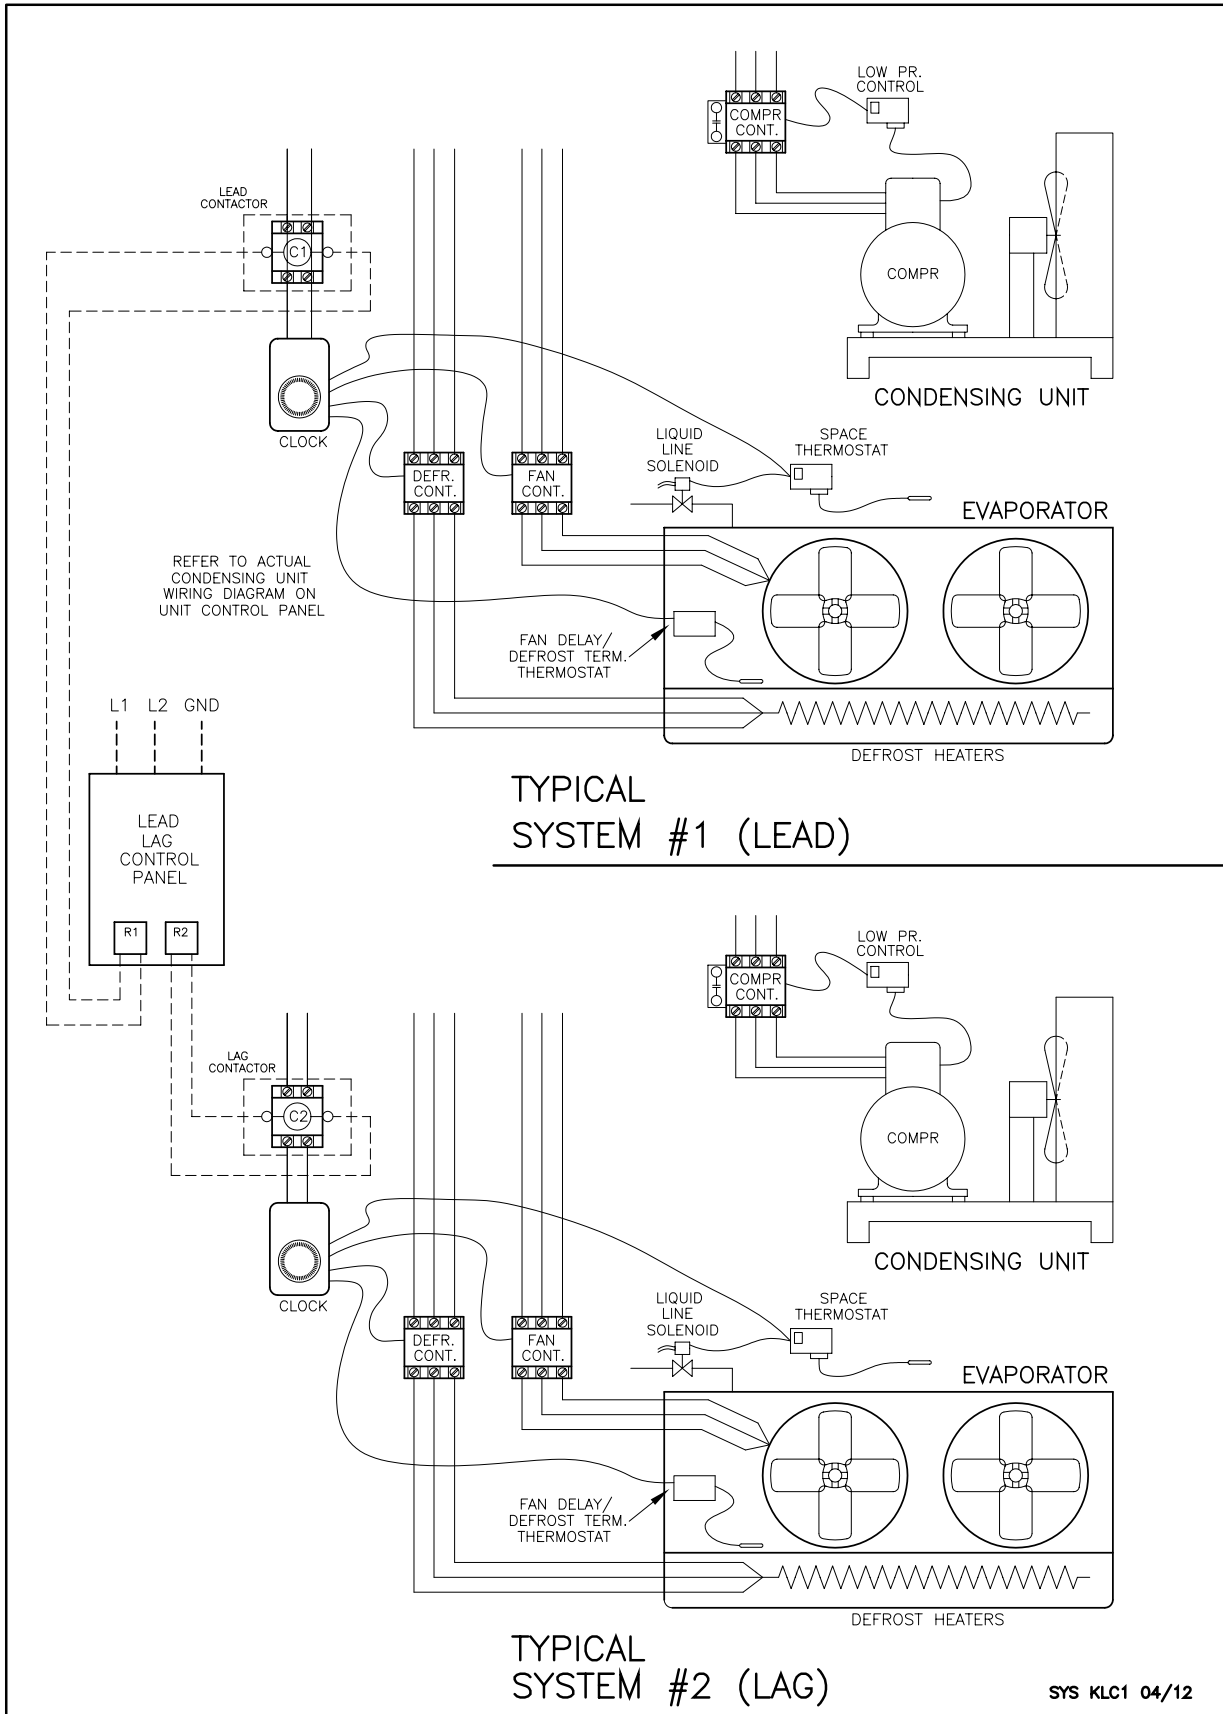

# PANEL LEAD-LAG WIRING - BLC2

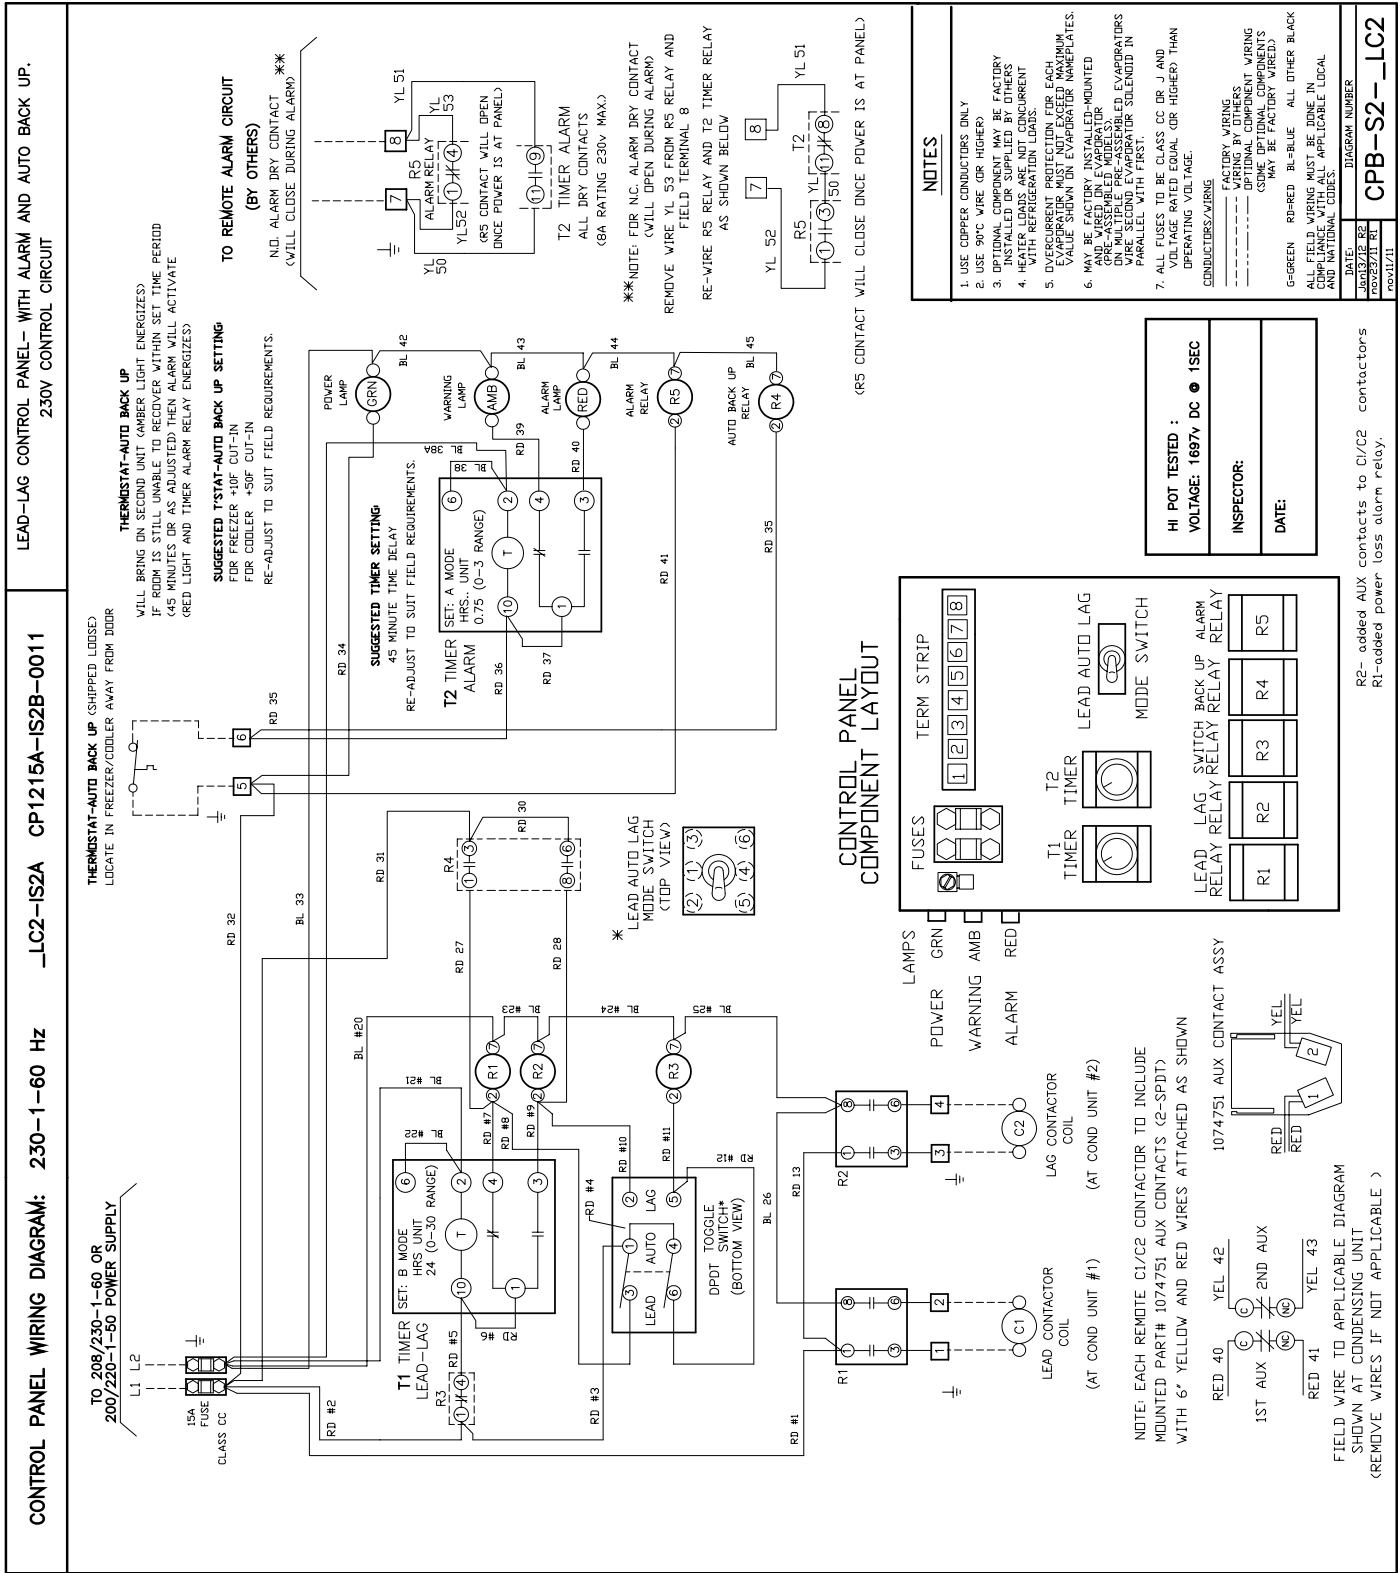


**SYSTEM LEAD-LAG WIRING -  
BLC2**

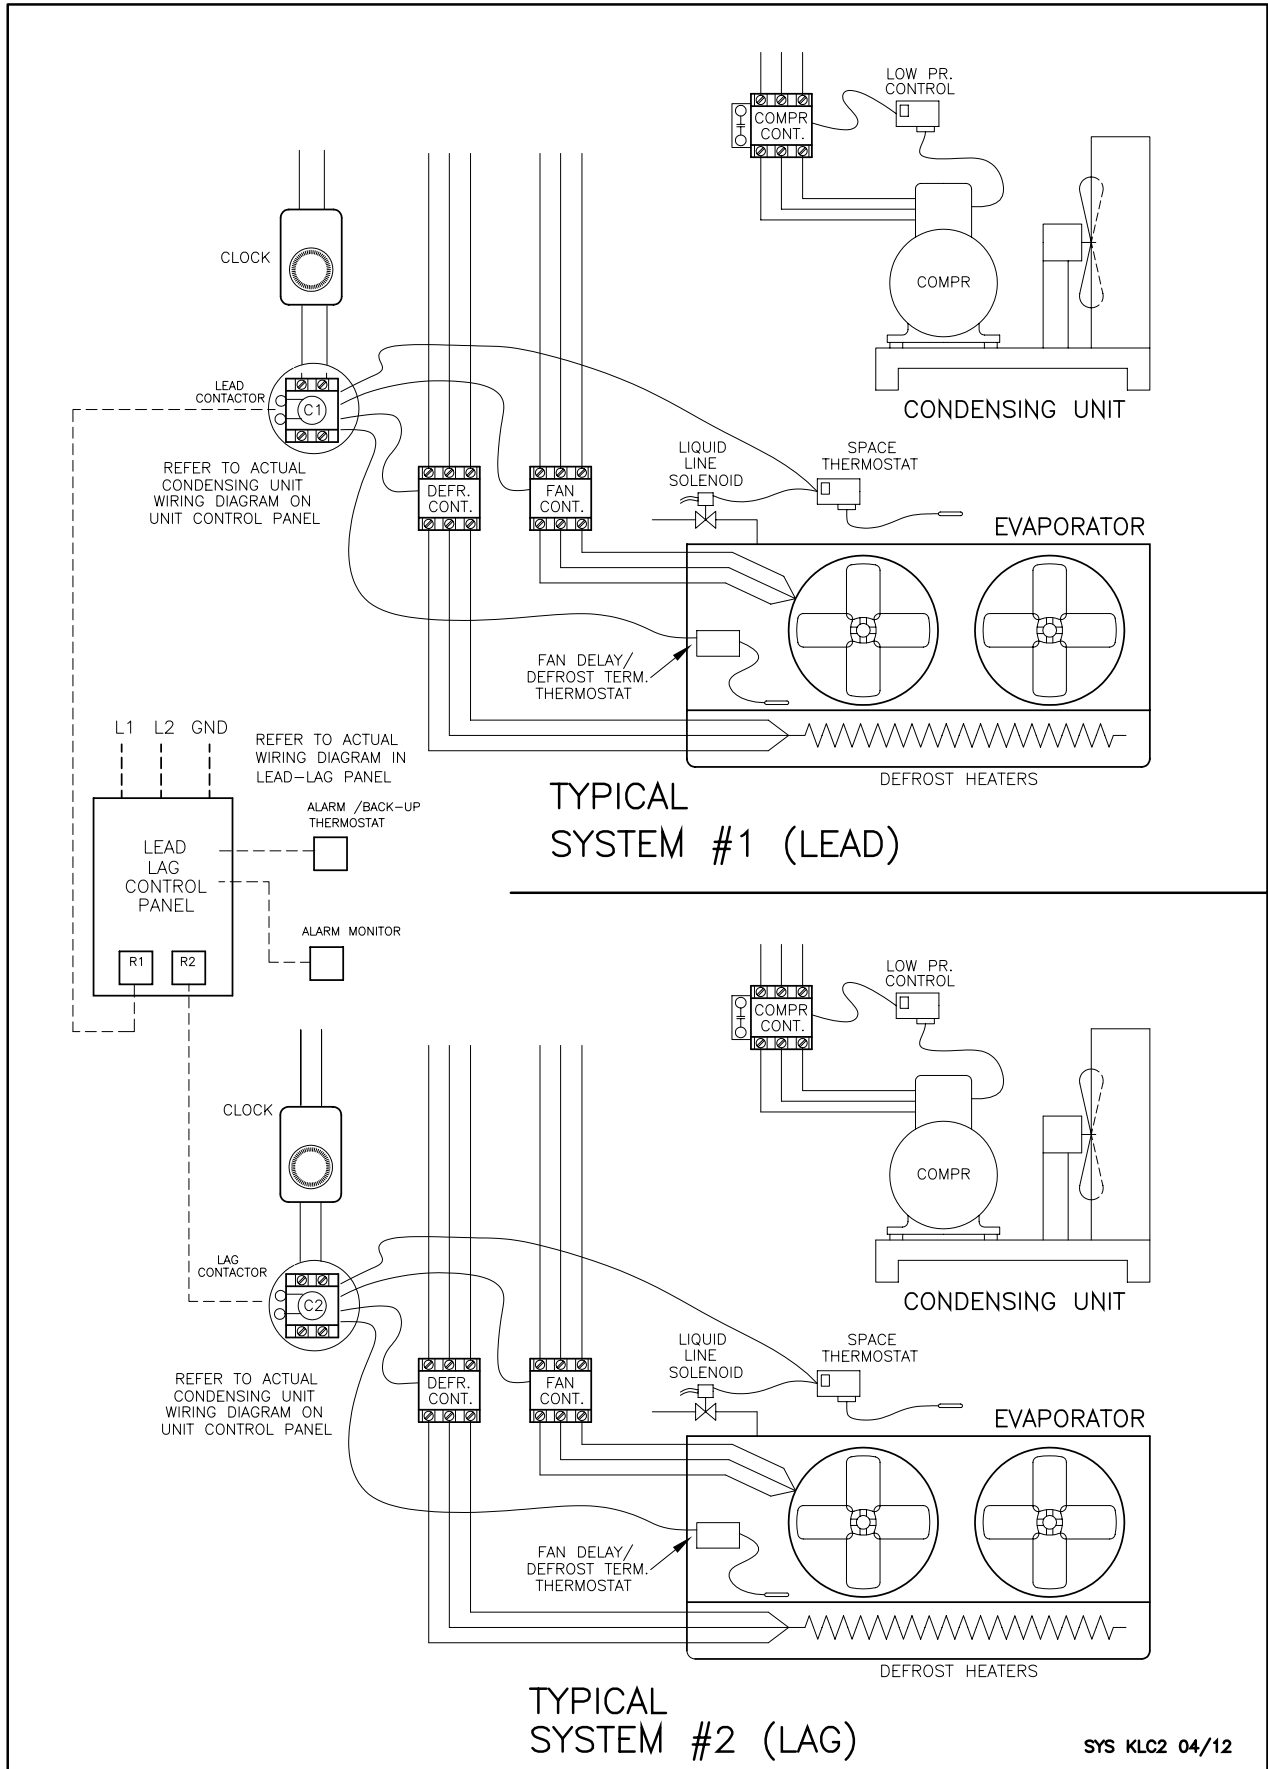

SYS KLC2 04/12

LEAD/LAG 2 PANEL AND EVAP. WIRING

REMOTE LEAD/LAG PANEL



TO LEAD C1 CONTACTOR COIL (---) AT COND UNIT#1  
TO LAG C2 CONTACTOR COIL (---) AT COND UNIT#2


REFER TO ACTUAL LEAD-LAG PANEL DIAGRAM AND CONDENSING UNIT WIRING DIAGRAM ON CONTROL PANELS.

ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.

CONDENSING UNITS ARE WIRED FOR PUMPDOWN MODE (CYCLE OFF ON LP CONTROL DURING PUMPDOWN).


LEAD UNIT#1 EVAPORATOR

ELECTRIC DEFROST

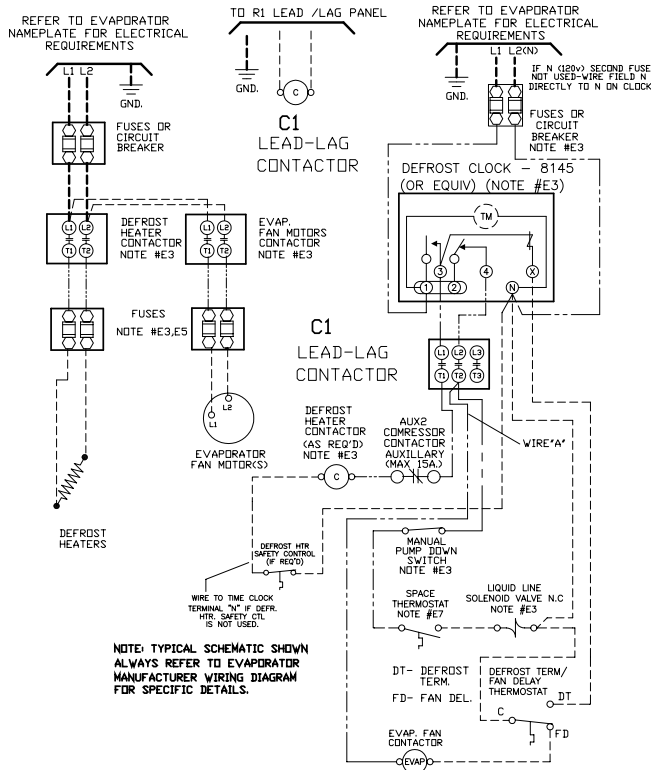

LAG UNIT#2 EVAPORATOR

ELECTRIC DEFROST

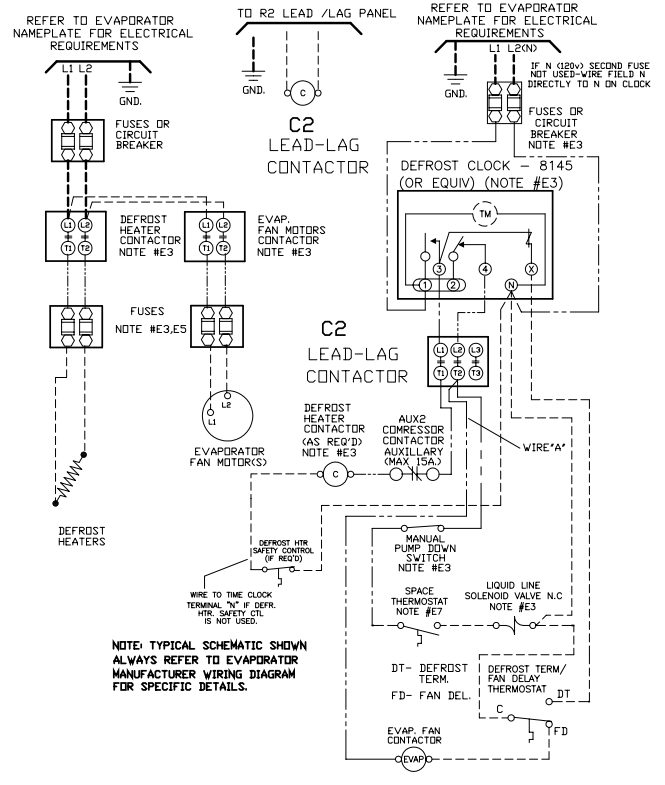

NOTE: FOR CONSTANT EVAP FAN OPERATION DURING LAG MODE RE-LOCATE WIRE 'A' FROM T2 TO L2 ON LEAD-LAG CONTACTOR

## OPTIONAL FIELD WIRING FOR PANEL POWER LOSS - BLC2


### OPTIONAL FIELD WIRING FOR LEAD/LAG 2 PANEL POWER LOSS

IN THE EVENT THE MAIN LEAD-LAG PANEL LOSES POWER A MASTER ALARM WILL BE ACTIVATED. TO ENSURE POWER IS STILL AVAILABLE TO THE LIQUID LINE SOLENOID CIRCUIT , WIRE THE FOLLOWING BYPASS CIRCUIT ALLOWING CIRCUIT POWER TO THE LIQUID SOLENOID AND FANS (NOTE MAX TOTAL 12A)

#### ADDITIONAL WIRING TO C1/C2 CONTACTORS

LEAD UNIT#1 PANEL

LAG UNIT#2 PANEL

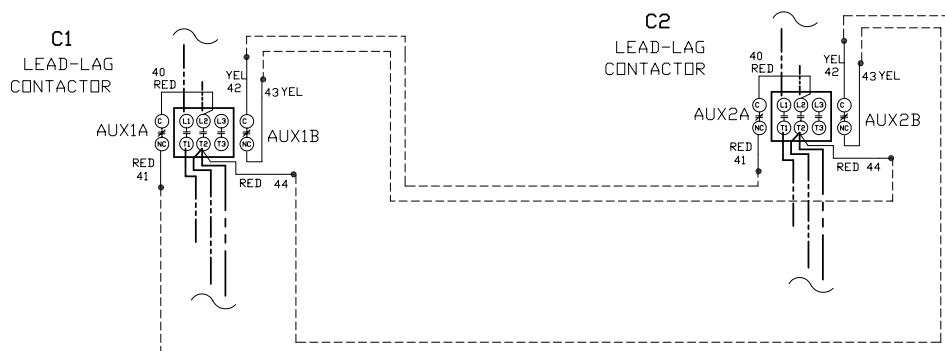

NOTE: SEE COMPLETE DIAGRAM ON P.1

# PRODUCT SUPPORT RESOURCES

 PRODUCT SUPPORT	<p><i>web:</i> <a href="http://b-rp.ca/blc">b-rp.ca/blc</a> <i>email:</i> <a href="mailto:smcu@b-rp.ca">smcu@b-rp.ca</a> <i>call:</i> 1-844-893-3222 x521</p>
 TROUBLESHOOTING	<p><i>email:</i> <a href="mailto:troubleshooting@b-rp.ca">troubleshooting@b-rp.ca</a> <i>call:</i> 1-844-893-3222 x529</p>
 SERVICE PARTS	<p><i>web:</i> <a href="http://b-rp.ca/parts">b-rp.ca/parts</a> <i>email:</i> <a href="mailto:parts@b-rp.ca">parts@b-rp.ca</a> <i>call:</i> 1-844-893-3222 x501</p>
 WARRANTY	<p><i>web:</i> <a href="http://b-rp.ca/warranty">b-rp.ca/warranty</a> <i>email:</i> <a href="mailto:warranty@b-rp.ca">warranty@b-rp.ca</a> <i>call:</i> 1-844-893-3222 x501</p>
 ORDERS	<p><i>email:</i> <a href="mailto:orders@b-rp.ca">orders@b-rp.ca</a> <i>call:</i> 1-844-893-3222 x501</p>
 SHIPPING	<p><i>email:</i> <a href="mailto:shipping@b-rp.ca">shipping@b-rp.ca</a> <i>call:</i> 1-844-893-3222 x503</p>



General Sales, Parts & Service, Manufacturing & Engineering  
135 Little Nine Drive, Morehead City, NC 28557  
252-240-2829 • 1-800-24-BALLY • FAX: 252-240-0384  
e-mail: [ballysales@ballyrefboxes.com](mailto:ballysales@ballyrefboxes.com) • [www.ballyrefboxes.com](http://www.ballyrefboxes.com)



DISTRIBUTED BY:

